


NOTES

1. MINIMUM 300mm VERTICAL AND HORIZONTAL SEPARATION TO BE MAINTAINED BETWEEN WATER AND WASTE WATER/ STORM WATER PIPES.
2. PLACE SELECT BACKFILL MATERIAL, MAX. 50mm AROUND SERVICE BOX TO SUBGRADE.
3. PROVIDE 6.0m HORIZONTAL SEPARATION FROM ANY PORTION OF WASTE WATER DISPOSAL FIELD.

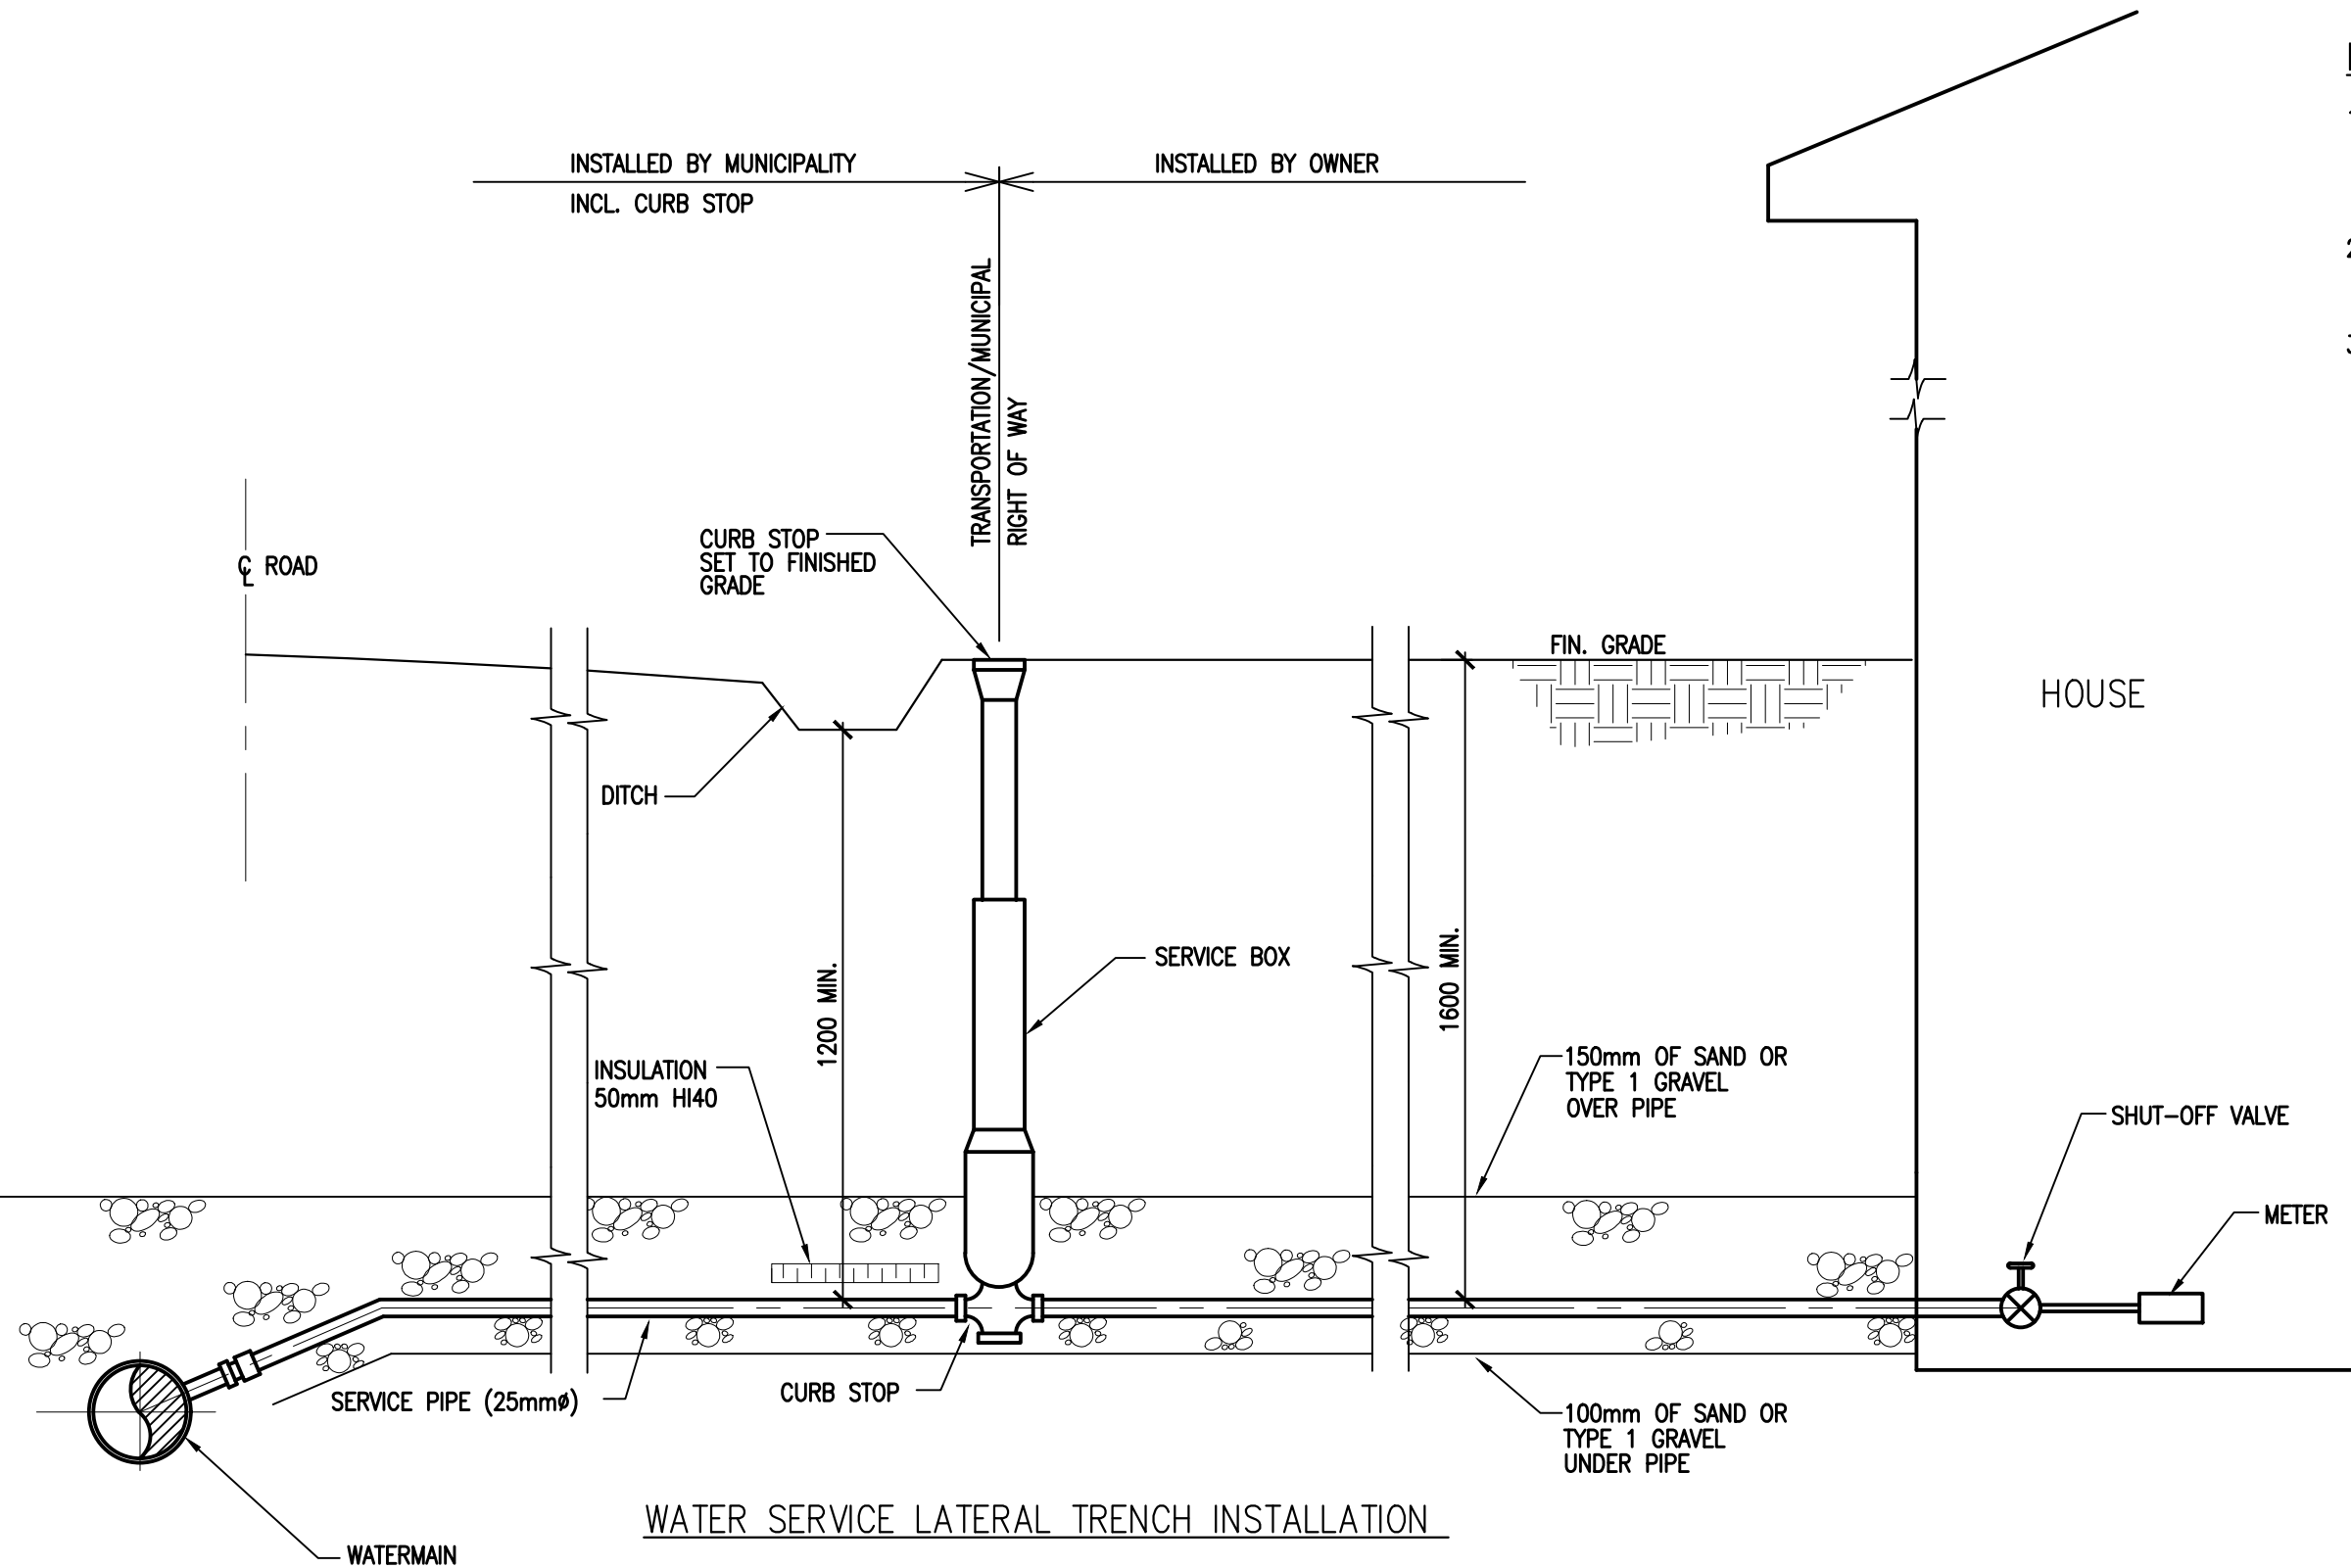

WATER SERVICE LATERAL TRENCH INSTALLATION

**GUIDELINE
WATER SERVICE LATERAL INSTALLATION
MUNICIPALITY OF CUMBERLAND**

Drn. By : JVE	Date : SEPT. 2017	Scale : NTS	Contract J47-27217
Checked BJG	Date : SEPT. 2017	Revision. 0	Dwg. SK1